


PLAN-76th FL.-SS-75E

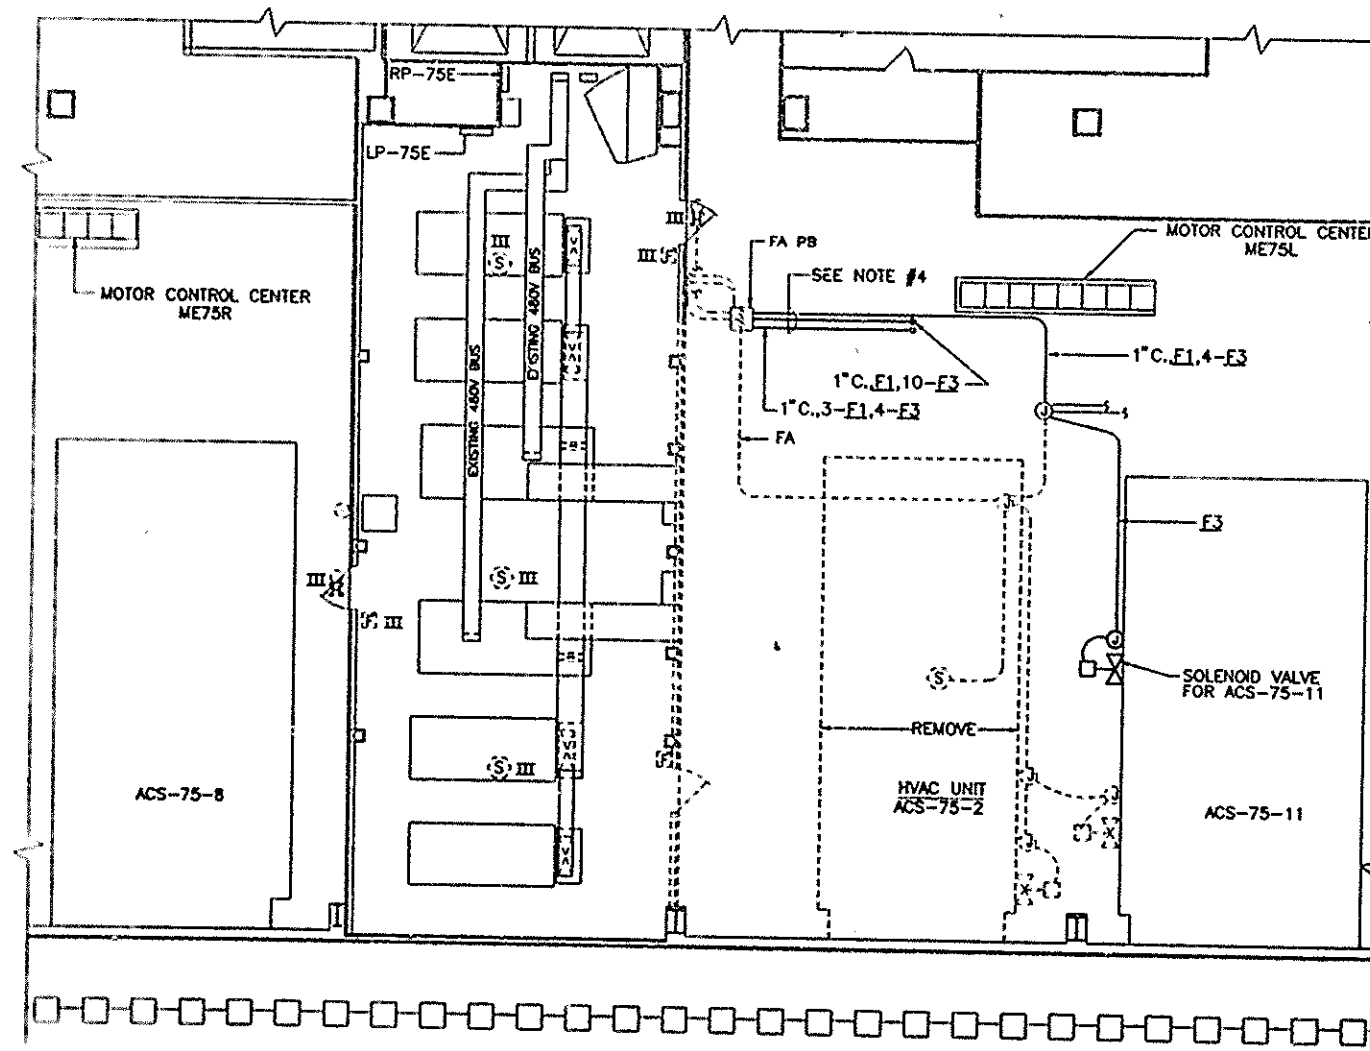

PLAN-75th FL.-SS-75E

NOTES

1. FOR LEGEND SEE DWG. #E-1, FOR GENERAL NOTES, ABBREVIATIONS AND LIGHTING FIXTURE SCHEDULE SEE DWG. #E-2.
2. FOR TYPICAL SUBSTATION STAGE I SEQUENCE OF INSTALLATION SEE DWG. #E-4.
3. REMOVE ABANDONED FIRE ALARM SYSTEM 3 DEVICE AND/OR CONDUIT SECTION.
4. INTERCEPT AND REROUTE EXISTING WIRING SYSTEM TO PROVIDE SPACE FOR NEW INSTALLATION. PROVIDE JUNCTION BOX AT ENDS OF CONDUITS THAT REMAIN. INSTALL WIRE IN REROUTED CONDUIT SECTION AS SHOWN AND SPLICE TO EXISTING WIRES IN JUNCTION BOXES.

Sheet 165 of 224



THE PORT AUTHORITY
OF NY & NJ

Peter L. Sweeney
ENGINEERING PROGRAM MANAGER
WORLD TRADE CENTER
C. R. ...
CHIEF ELECTRICAL ENGINEER

Engineering Department
Design Divisions
The World Trade Center
Electrical/HVAC
Upgrade Program

Title
TOWER ONE AND TWO
LOW VOLTAGE
SUBSTATIONS
CONSTRUCTION AND
INSTALLATION
ELECTRICAL
SUBSTATION SS-75E
STAGE I
REMOVAL AND
RELOCATION PLANS
SHEET #2

No.	Date	Revision	Approved
1	6/21/95	Sultan A.
2	8/15/95	Peter L. Sweeney	...

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

Desiged by	Drawn by	Checked by
ROYZMAN FISCHER	ROYZMAN	...

Date 5-1-95 Scale AS NOTED

Contract Number WTC 802.071 Drawing Number E-79

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-802.071 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 6/21/95 *Sultan A. ...* SPEC. WRITER
DATE 8/15/95 *Peter L. Sweeney* ENGINEER OF DESIGN

